


LA1KN40 Auxiliary Contact Block

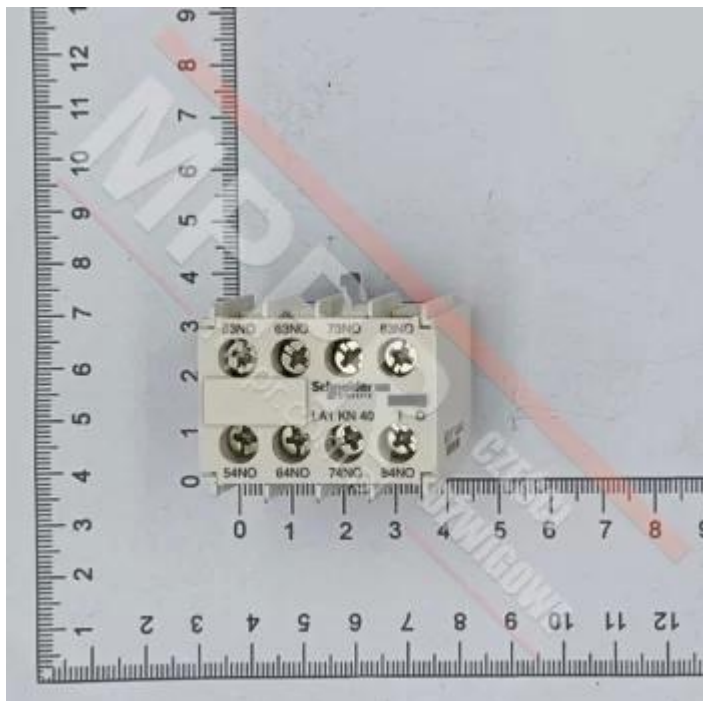

TeSys K auxiliary contact block; 4 NO contacts, screw-clamp terminals

Minimum Switching Current: 5 mA


Minimum Switching Voltage: 17 V

Height (mm): 30

Width (mm): 38

Depth (mm): 35

Photo gallery

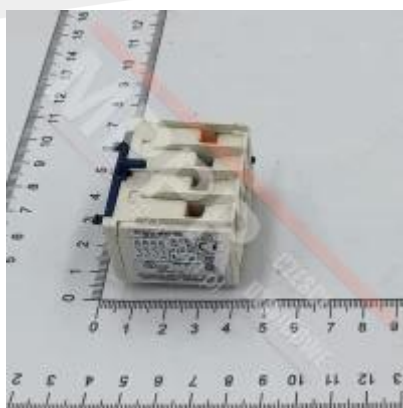

MPPR Sp. z o.o.

ul. Kolejowa 11/13, 01-217
Warszawa
NIP: PL5272974730
Tel: +48 22 631 22 83
mppr@op.pl

Biuro

Tel: +48 600 826 485
biuro@mppr.com.pl

Sprzedaż i marketing

Marcin Nasiadek
Tel: +48 668 592 976
admin@mppr.com.pl

Finanse i faktury

Krzysztof Ząbek
Tel: +48 22 631 22 83
zabek@mppr.com.pl